


QUADRI DI STRINGA CABLATI
Serie MB – Scheda tecnica

- Approvazioni e Conformità
• Direttiva Bassa Tensione 2006/95/CE
• EN IEC 61439-1/2
• CEI 17-13/1
• CEI 82-25.



Bremas Ersce S.p.A.
Via Castellazzo 9 – 20040 Cambiago (MI)
Tel +39 02 95651611 Fax +39 02 95651639
www.bremas.it info@bremas.it
ISO 9001 Certified Quality System

Table with 4 columns: Feature, Value 1, Value 2, Value 3. Sections include MBX10A21T2F20T32, CARATTERISTICHE COSTRUTTIVE, SEZIONE DC, and SEZIONE AC.

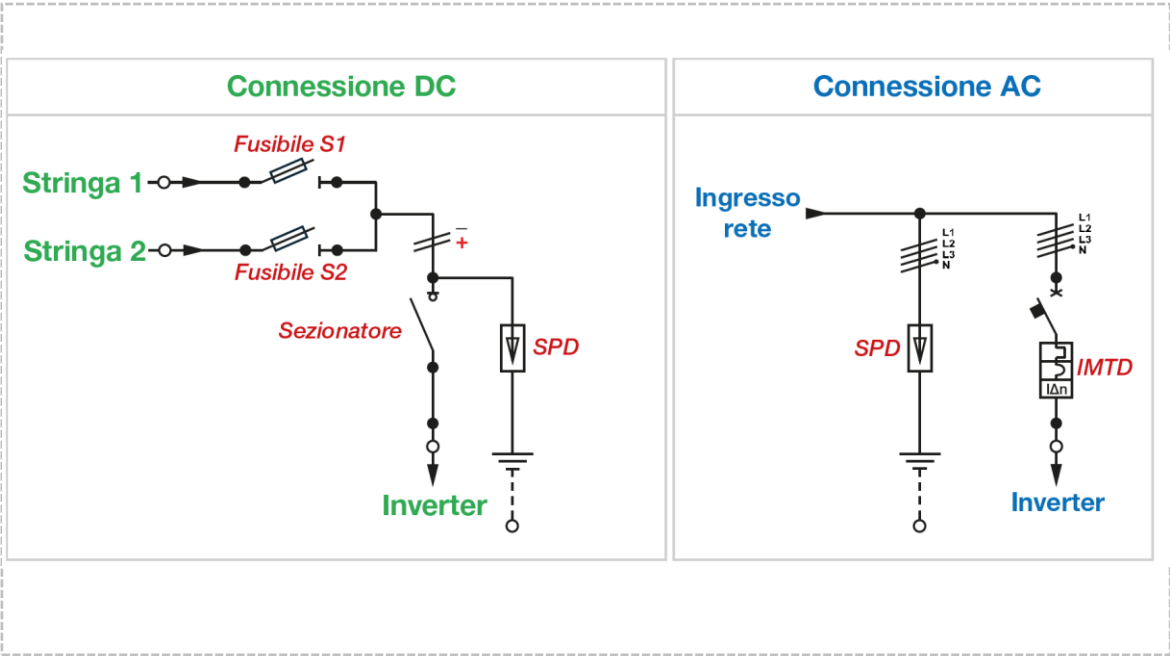

©2026 Copyright Bremas Ersce. Subject to change without notice and errors excepted. Data reported in this paper are carefully checked and represent typical values of series production. The descriptions of the device and its applications, contexts of use, details of external controls, information on installation and operation are provided to the best of our knowledge. In any case, this does not mean from the features described it may derive legal responsibilities that extend beyond the "Terms and Conditions of sales" of Bremas Ersce. The customer / user must examine our information and recommendations and the relevant technical regulations before using the products its own purpose.